IF IN DOUBT ASK. **Engineering**

ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED

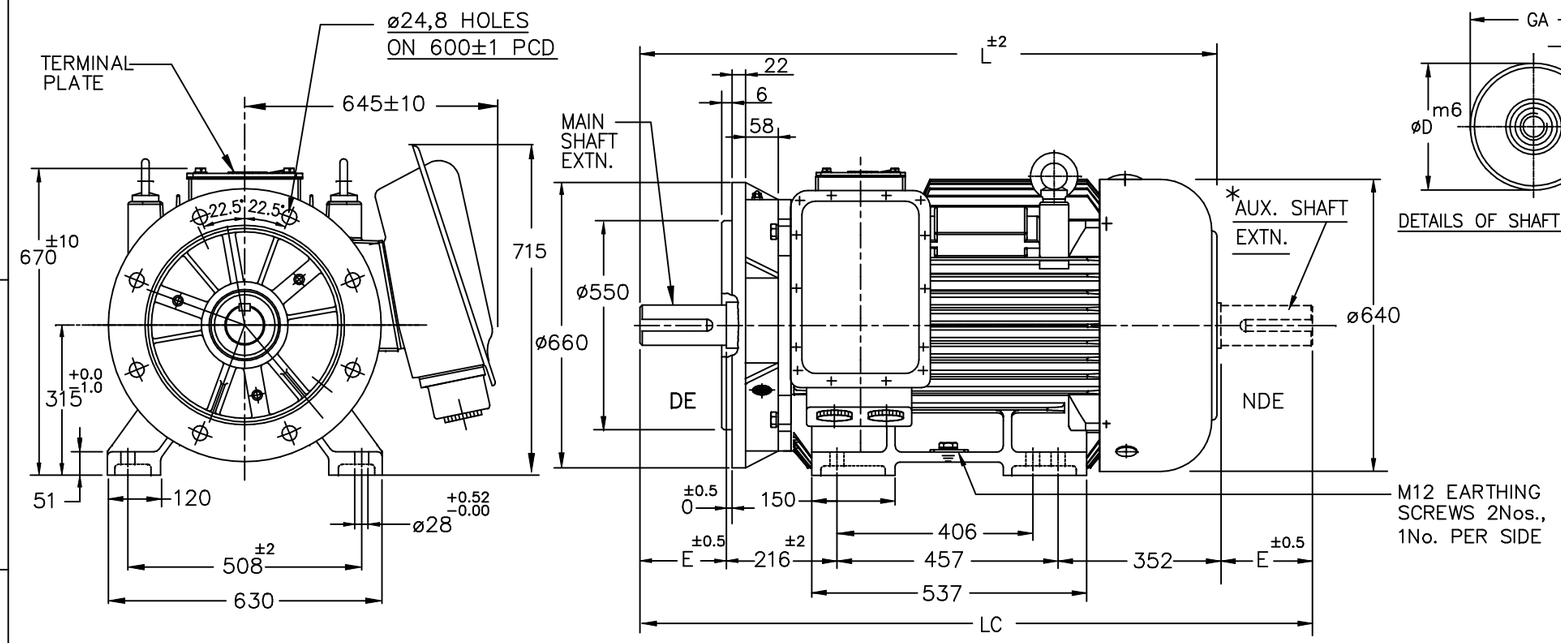



DETAILS OF SHAFT EXTENSION

NOTE :

1. DIMENSIONS ARE AS PER IS:1231
2. DEGREE OF PROTECTION / COOLING: IP:55/IC:411.
3. TERMINAL BOX CAN BE ROTATABLE THROUGH 360° IN STEPS OF 90°.
4. KEY & KEYWAY ARE AS PER IS:2048 & TOLERENCE ON KEYWAY IS P9.
5. PROTECTED CENTRE HOLE AT SHAFT EXTENSION AS PER IS:2540. M20x40
6. * OPTIONAL INCASE OF DOUBLE SHAFT EXTENSION
7. UNLESS OTHERWISE SPECIFIED TERMINAL BOX WILL BE ON RHS WITH SINGLE SHAFT EXTENSION

RC315SM	4,6&8	80	170	22	85	14	1185	1365
	2	65	140	18	69	11	1155	1305
FRAME	POLE	D	E	F	GA	GD	L	LC

TERMINAL BOX ARRANGEMENT

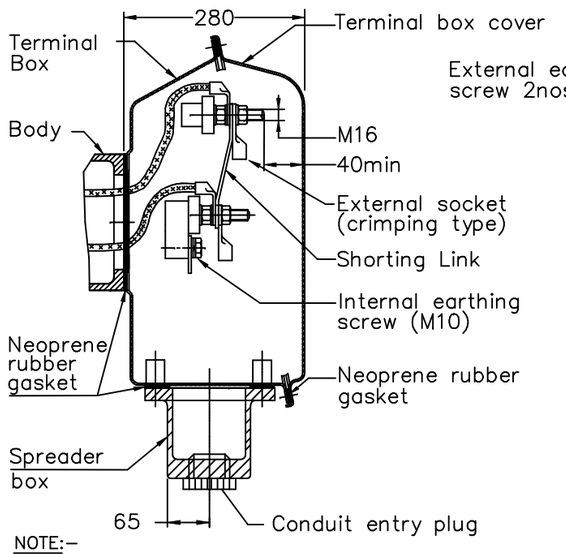

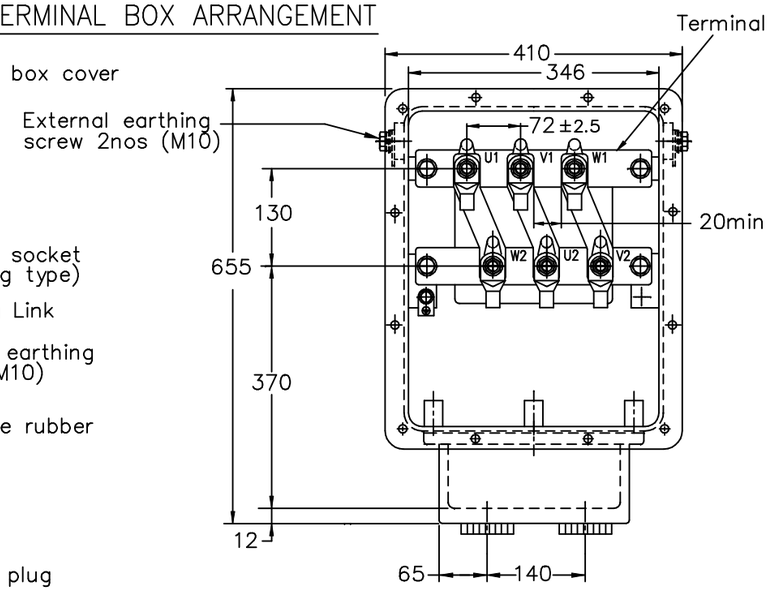

NOTE:–

1. MINIMUM ELECTRICAL CLEARANCE AND CREEPAGE DISTANCES ARE AS PER BS:4999, PART–145.
2. MAX. CABLE SIZE:– 2 OF 3 C x 240 Sq.mm AYFY.

ITEM/TAG No.			
RATING		PROJECT :	
CABLE SIZE		CONSULTANT	JOB No.

REV.	ZONE	BRIEF RECORD	SIGNATURE	DATE

ALL INFORMATION CONTAINED IN THIS DOCUMENT IS CONFIDENTIAL AND THE PROPERTY OF **KIRLOSKAR ELECTRIC CO. LTD.** REPRODUCTION OF THESE IN ANY FORM IS TO BE DONE WITH THE SPECIFIC PERMISSION OF THE COMPANY.

PRINTS ISSUED TO

	DRAWING No.	FROM DT.	SIGN & DATE.
THIS SUPERSEDES	———	——	———
THIS IS SUPERSEDED BY	———	——	———

CUSTOMER / O/A No.

SCALE

USED ON / TYPE FBRC315SM (DOUBLE ENTRY WITHOUT GLAND)

DRAWN	SPC	2.8.2016
CHECKED	VSH	2.8.2016
APPROVED	RNV	2.8.2016

TITLE: DIMENSION SHEET

KHD61686

SHEET NO. ONE OF ONE

KIRLOSKAR ELECTRIC COMPANY LTD. HUBLI – 580030 (INDIA)

FORM No. 02 201 049 (ISSUE 8)