




- NOTE:
- 40mm THICK & 40KG/m<sup>3</sup> DENSITY FOAM GLUED TO ALL INSIDE FACES OF WALLS, DOORS, COIL LINGS, RADIATOR, ALTERNATOR DUCTS, TOP/BOTTOM BEAMS, ROOF AND Baffle PLATES IN ALTERNATOR SIDE EXCEPT PINCH AREA.
  - USE ONLY Zn WITH BLUE PASSIVATED FASTENERS.
  - CANOPY PARTS SHALL BE POWDER COATED IN BLUE STRUCTURE FINISH EXCEPT ROOF, BASE FRAME AND PUNCH MESH WHICH ARE IN GAL.5000 STRUCTURE FINISH.
  - SHEET THICKNESS FOR ALL CANOPY PARTS ARE IN 1.2mm THK CRCA SHEET.
  - SHEET MATL. FOR PRESSED CHANNELS IN MAIN FRAME CRCA 3mm & HR 4mm THICK.
  - ALL JOINTS BETWEEN ROOF, COLUMNS AND TOP BEAMS ARE SHALL BE PASTED WITH 40mm WIDTH BY 3mm THICK NOISE INSULATING TAPE TO AVOID NOISE LEAKAGES.
  - TOLERANCE ON OVERALL DIMENSIONS IS  $\pm 20$ mm.
  - ALL DOORS RUBBER BEADING BULB DIA. 12mm.
  - ALL EXTERNAL FASTENERS, CANOPY LOCKS & HINGES ARE IN STAINLESS STEEL.

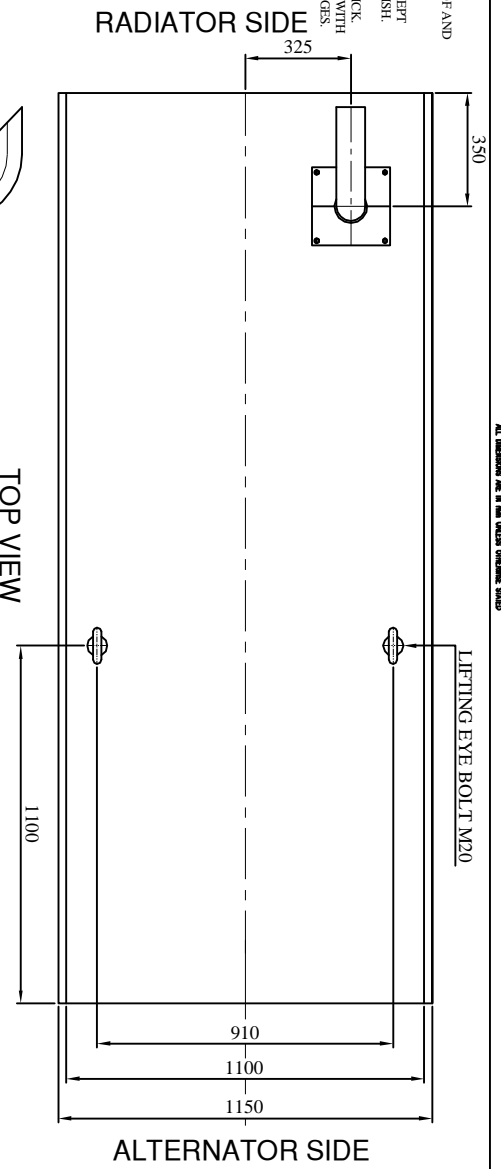


TOP VIEW

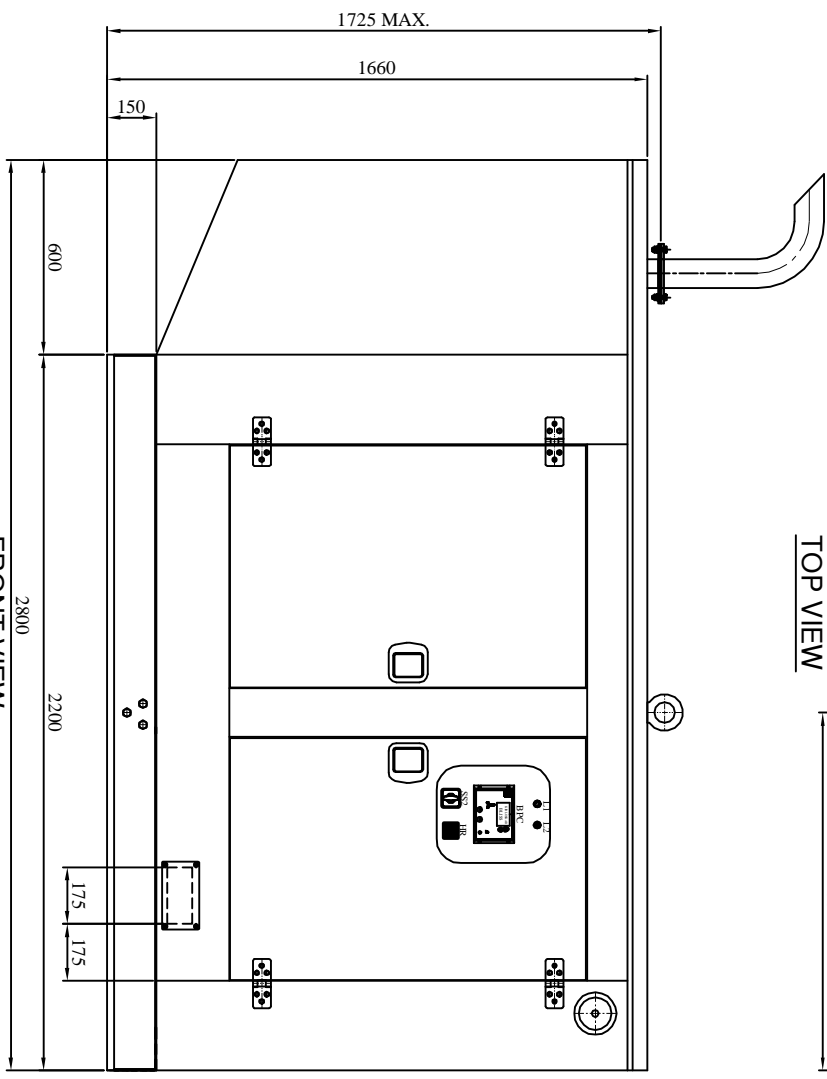

FRONT VIEW

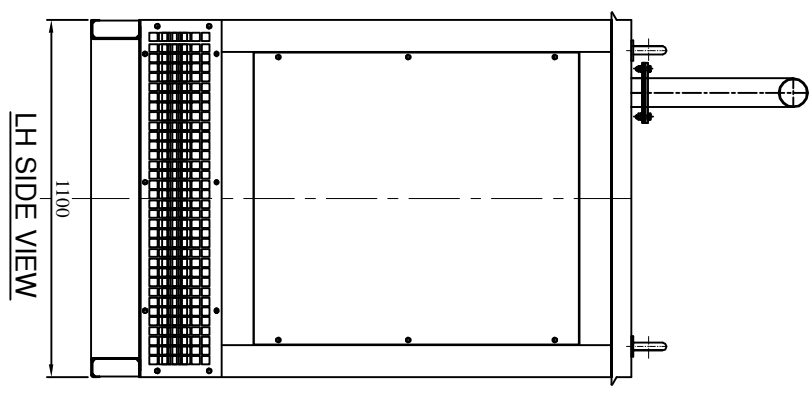

LH SIDE VIEW

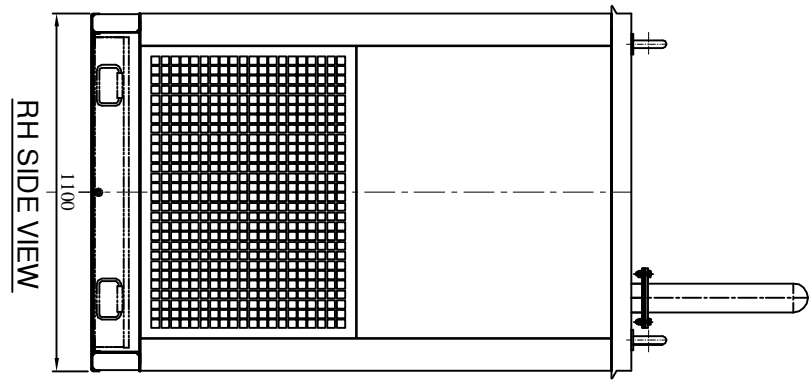

RH SIDE VIEW

UNFINISHED DIMENSIONS		FINISHED DIMENSIONS	
NO.	DESCRIPTION	NO.	DESCRIPTION
1	...	1	...
2	...	2	...
3	...	3	...
4	...	4	...
5	...	5	...
6	...	6	...
7	...	7	...
8	...	8	...
9	...	9	...
10	...	10	...
11	...	11	...
12	...	12	...
13	...	13	...
14	...	14	...
15	...	15	...
16	...	16	...
17	...	17	...
18	...	18	...
19	...	19	...
20	...	20	...

DESIGNER	DATE	CHECKED	DATE
...	...	...	...
TITLE: G.A. DRAWING OF ACQUSTIC KEK-T63-II KVA D.G. SET Dwg SET 40 TO 63 KVA/Hrs 12503614F000000			